




# Test Report Specifications

## Ultra DH / CS 6000 DH

**ANSI/AMAA/NWWDA 101/I.S-97**  
**Report # 57194.02-701-47**  
**NAMI Certificate NI0015006**

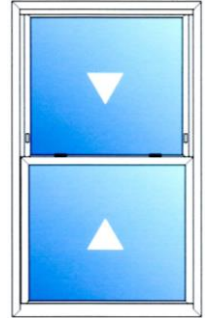

### Summary of Results

Title	Specimen 2
Rating	<b>DP H-R25</b> 44 x 60
Operating Force	24 lbs max
Air Infiltration	0.08 cfm/ft <sup>2</sup>
Water Resistance Pressure	6.00 psf
Uniform Deflection Pressure	625.0 psf
Uniform Structural Pressure	637.5 psf
Deglazing	Passed
Forced Entry Resistance	Grade 10

**NFRC 100-2014/200-2014/500-2014**  
**Report # G8982.01-116-45**

Base Unit Validated 47.25" x 59.00"	
Simulated Thermal Transmittance (U-Factor)	0.30

### Specific Thermal Results

Spacer Type	Super Spacer				Specifically for the Northern Climate Zone	
	E-Max* (Low-e <sup>2</sup> ) w/ Argon		Advanced E-Max (Low-e <sup>3</sup> ) w/Argon		E-Max (Low-e <sup>2</sup> ) & 189 w/Argon	
	No Grids	w/ Grids	No Grids	w/ Grids	No Grids	w/ Grids
<b>U-Factor</b>	<b>0.29</b>	<b>0.29</b>	<b>0.29</b>	<b>0.29</b>	<b>0.25</b>	<b>0.25</b>
<b>SHGC</b>	<b>0.28</b>	<b>0.25</b>	<b>0.21</b>	<b>0.19</b>	<b>0.27</b>	<b>0.24</b>
VT	0.52	0.46	0.48	0.42	0.50	0.45
CR	58	58	58	58	46	46